


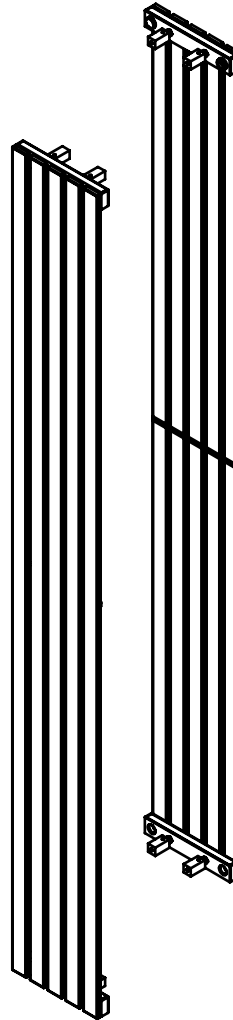
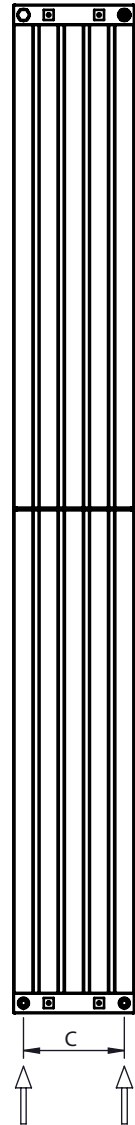


CANTI

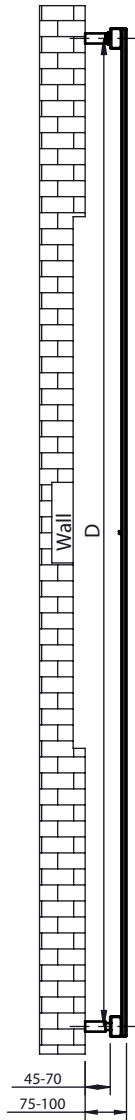

A	B	C	D	E	HEAT OUTPUTS (WATT)	HEAT OUTPUTS (BTU)
HEIGHT	LENGTH	PIPE CENTER	VERTICAL BRACKET CENTERS	HORIZONTAL BRACKET CENTERS	Delta T:50 °C	Delta T:50 °C
mm	mm	mm	mm	mm		
2000	240	200	1960	100	776	2646
2000	340	300	1960	200	1086	3705
2000	320	280	1960	200	1080	3683
2000	490	450	1960	350	1552	5292
2000	590	550	1960	450	1862	6349
1800	240	200	1760	100	698	2380
1800	340	300	1760	200	977	3332
1800	490	450	1760	350	1396	4760
1800	590	550	1760	450	1675	5712
1500	240	200	1460	100	582	1985
1500	340	300	1460	200	815	2779
1500	490	450	1460	350	1164	3969
1500	740	700	1460	600	1746	5954
1500	990	950	1460	850	2328	7938

Bracket Assembly

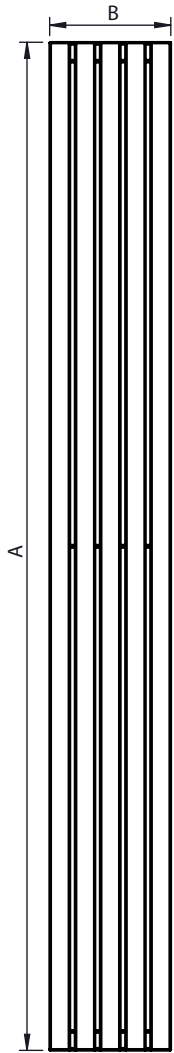